




Tank Information

ZONE	REV	DESCRIPTION	DATE	APPROVED
------	-----	-------------	------	----------

July 2009

FINAL APPROVED DRAWING  
 BY: \_\_\_\_\_  
 DATE: \_\_\_\_\_

Monitor Pipe

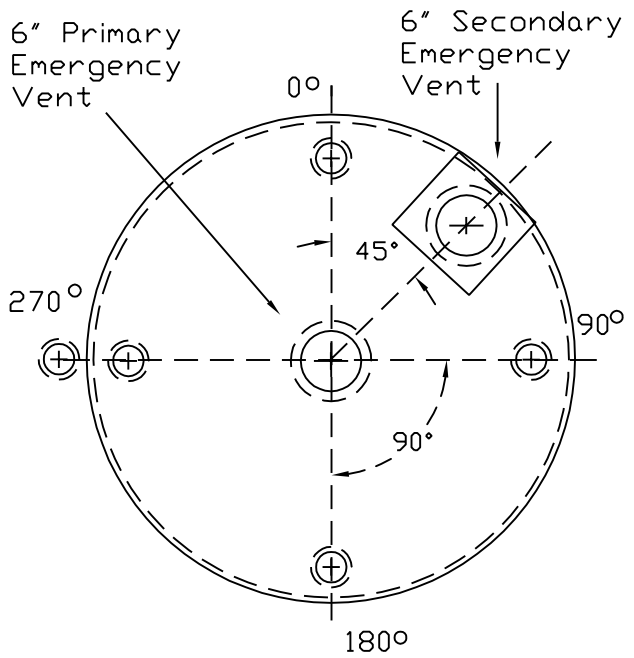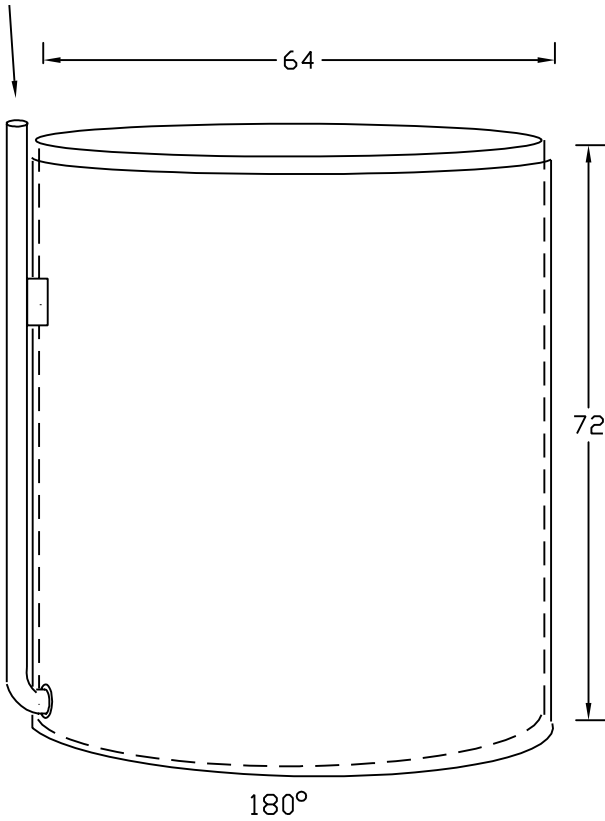

4 Ea, 2" Openings on Top,  
 Primary & Secondary  
 Emergency Vents



1000VDW

1000 Gallon Double Wall Vertical, 7 ga. Carbon Steel Construction, Standard Openings, 64 Dia, 72 Tall, Red Primer Coating

1333 North Douglas St  
 Florence, SC 29501  
 Telephone (843) 669-3381  
 Fax (843) 664-9118

UL142  
 Listed

For Stationery Use Only

REV

SCALE

M Moran

SHEET