


Tank Information


ZONE	REV	DESCRIPTION	DATE	APPROVED
			May 2009	


FINAL APPROVED DRAWING
 BY: _____
 DATE: _____

4" Emergency Vent Opening

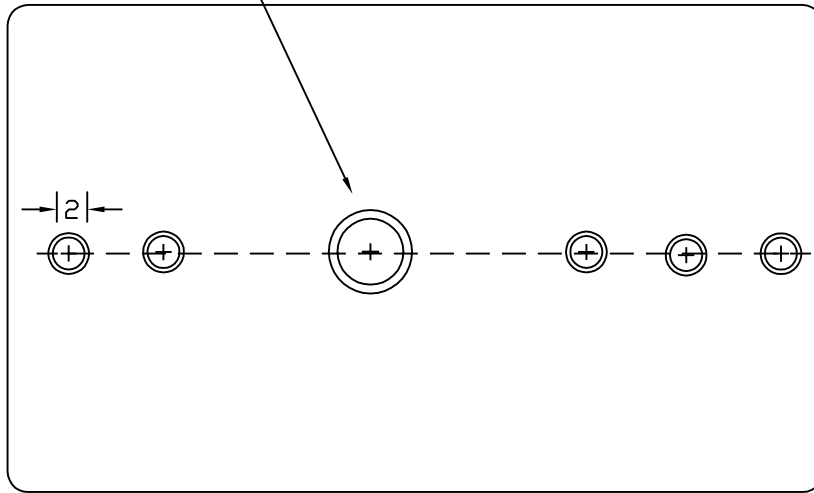

2" Drain Opening

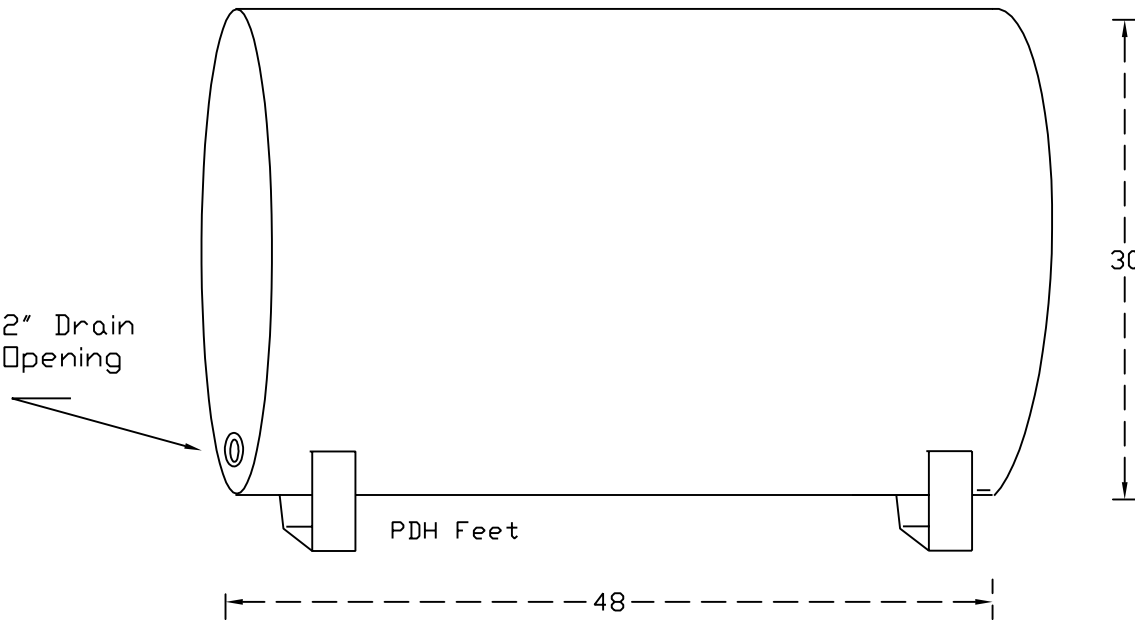

 Pee Dee Tank	150 Gallon PDH		
	30 X 48, Single Wall Construction, UL142 Listed, Standard Openings, 4" Em Vent Opening, Red Primer Top Coat		
1333 North Douglas St Florence, SC 29501 Telephone (843) 669-3381 Fax (843) 664-9118	UL 142 Listed	For Stationery Use Only	REV
SCALE	M Moran	SHEET	