


Tank Information


ZONE	REV	DESCRIPTION	DATE	APPROVED
------	-----	-------------	------	----------

June 2009


FINAL APPROVED DRAWING  
 BY: \_\_\_\_\_  
 DATE: \_\_\_\_\_

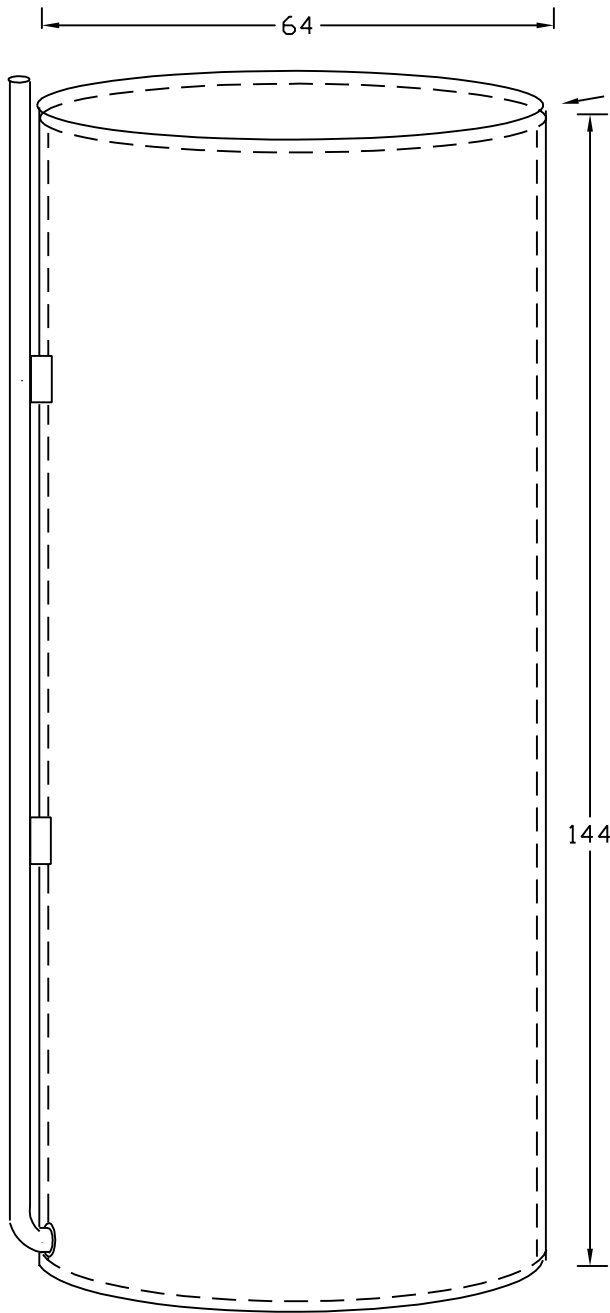


Outside Wrap of Double Wall comes to within a couple inches of top

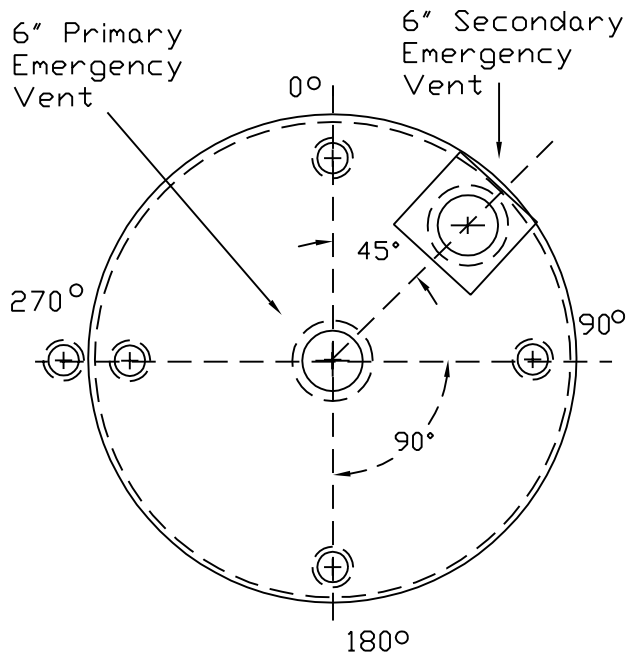

Standard 2" NPT  
 Openings at 0 &  
 180 degrees.  
 Standard 4" NPT  
 openings at 90 &  
 270 Degrees,  
 8" Emergency Vent  
 Center of Top



 <b>Pee Dee Tank</b> 1333 North Douglas St Florence, SC 29501 Telephone (843) 669-3381 Fax (843) 664-9118	2000 Gal Vertical DW			
	2000 Gallon Double Wall Vertical, 7 ga. Carbon Steel Construction, Standard Openings, 64 Dia, 144 Tall, Red Primer Coating			
	UL142 Listed	For Stationery Use Only	REV	
SCALE	M Moran	SHEET		